




**PURE POWER
PERFECTLY DEFINED**

DREAMS THAT ARE MEASURED IN VOLTS

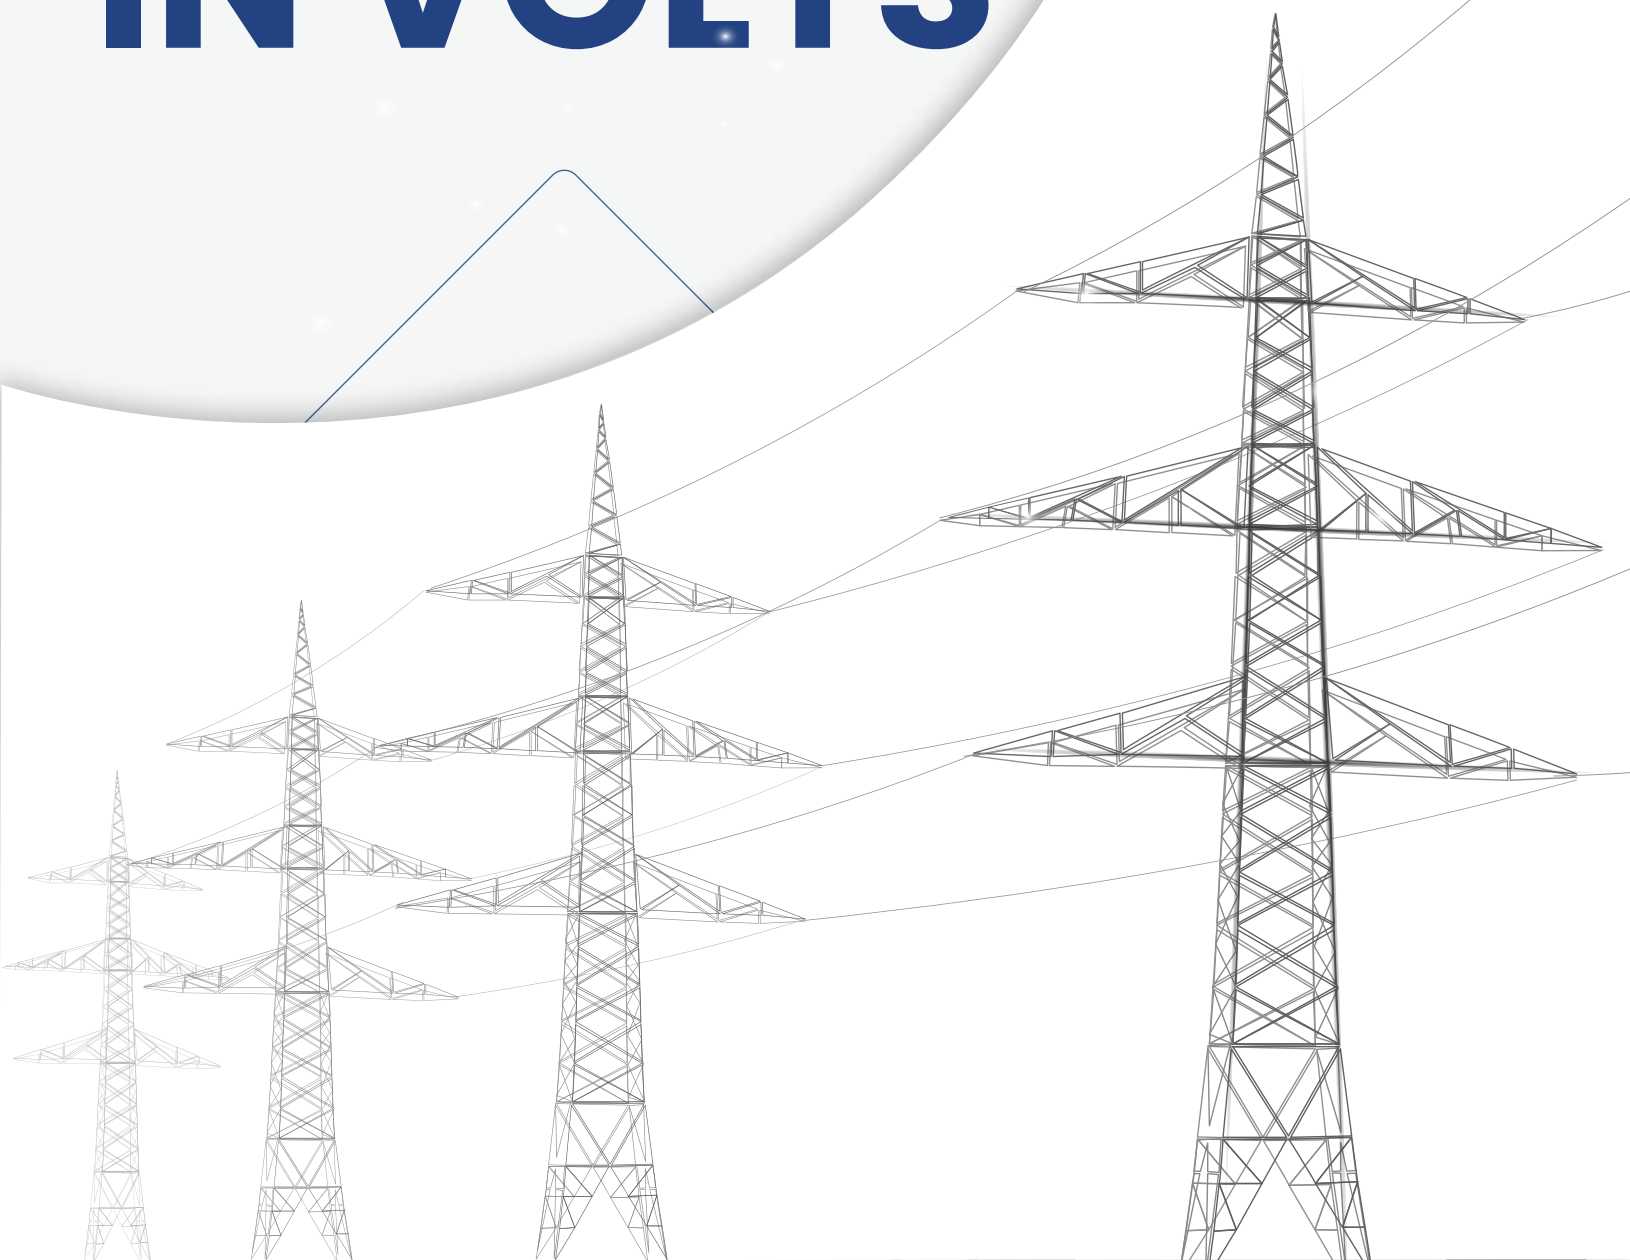

CONTENTS

ABOUT US	04
CHAIRMANS WORD	05
MISSION & VISION	06
CERTIFICATES	07
CONSTRUCTION OF XLPE LT CABLES	08
ADVANTAGES OF ORBIT XLPE CABLES	09
SELECTION OF CABLES	10
TECHNICAL DATA	11 – 23
CONSTRUCTION OF PVC LT CABLES	24
TECHNICAL DATA	25 – 35
CABLE HANDLING AND STORAGE	36 – 38

About Company

Orbit Group of Companies is a renowned wiring and cabling solution partner, established in 1996. We have dominated the trade and engineering of wires and cables for over two decades with dynamic and pioneering technology.

Orbit wires and cables are designed and manufactured by the industry's best and are continually evolving to stay ahead of market demands. Our trusted products are designed and fabricated with efficiency and focus on the minutiae to ensure a satisfactory experience for every customer.

Orbit wires and cables are credited to be a one-stop enterprise that manufactures and sells a variety of wiring and cabling solutions for diverse applications. As an established enterprise we promise to deliver reliable and standard wiring and cabling solutions for your specific needs at a competitive price.



Message From The Chairman



Mr. RK Agarwal
Founder

One of the core purposes of Orbit Wires India Pvt. Ltd. is to build a long term relationship with people and organizations across the globe. Orbit Wires Company has proactively worked towards creating brand credibility and recognition by maintaining the industry standards of our products. We strive to be an innocuous company with safety as our precedence and aim to ultimately have zero accidents. We aspire to be the best cable manufacturer in the country and establish our brand identity through quality product delivery and commitment towards customer value.



Mr. Amit Agarwal
Managing Director



Ms. Neelam Bansel
Managing Director




Mr. Govinda Agarwal
Managing Director

Mission Vision & Values

One of the core purposes of Orbit Wires India Pvt. Ltd. is to build a long term relationship with people and organizations across the globe. Orbit Wires Company has proactively worked towards creating brand credibility and recognition by maintaining the industry standards of our products.

We strive to be an innocuous company with safety as our precedence and aim to ultimately have zero accidents.

We aspire to be the best cable manufacturer in the country and establish our brand identity through quality product delivery and commitment towards customer value.

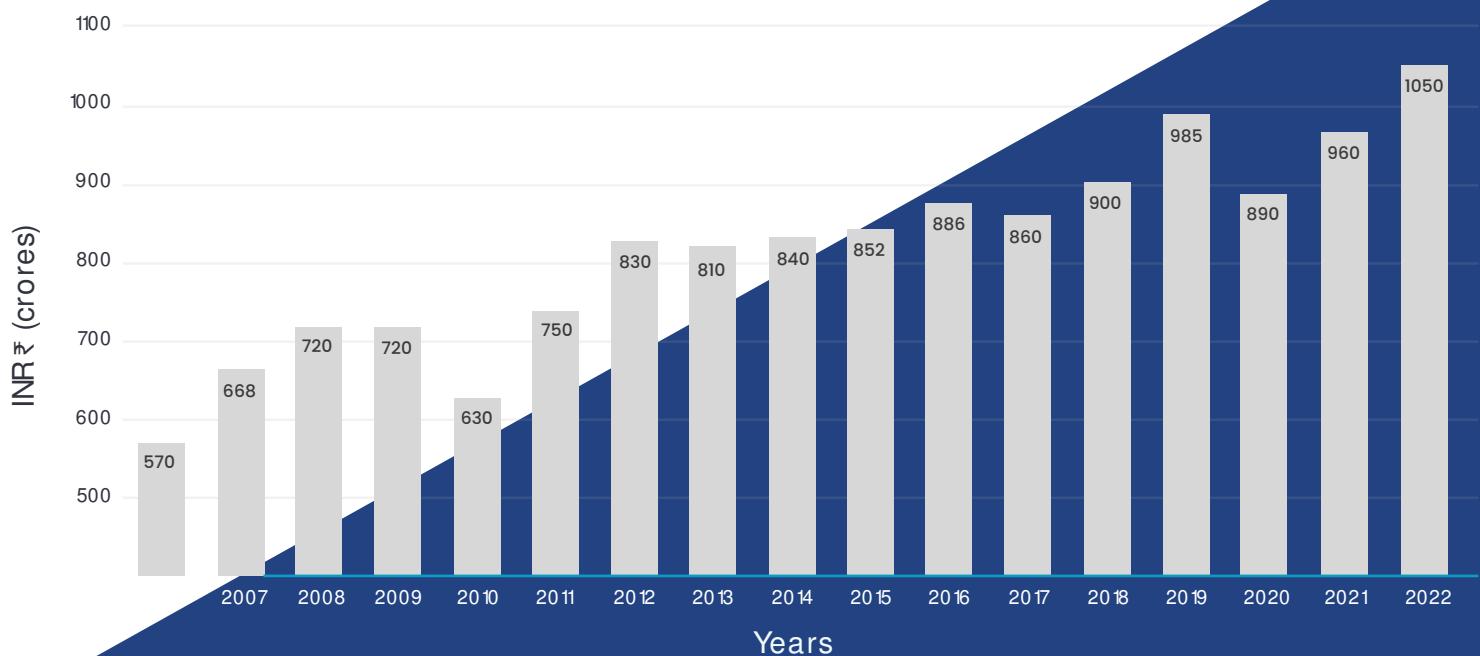

Certificates



QMS



EMS



HEALTH & SAFETY



CE



ROHS



CPRI

CONSTRUCTION OF LT CABLES

XLPE INSULATED ALUMINIUM ARMoured CABLES

Application :

Power cables for medium voltage (upto 3.3kv) are used in – outdoor cable ducts, cable trays, conduits or underground locations under mechanical stresses in power and switching stations, local distribution systems and industrial plants.

Standards	IS 8130 : 2013, IS 5831 : 1984, IS 7098 : 1 : 1988
Operating Temperature	90°C
Short Circuit Temperature	250°C
Working Voltage	600/1000 Volts
Cable Range manufactured Sizes	50 sq.mm to 630 sq.mm in Single Core Cables 25 sq.mm to 400 sq.mm in Multi Cores Cables

Test Voltage :

3300 V

Construction :

Conductor Aluminium Stranded compacted circular conductor conform to IS 8130 : 2013, Class 1 or Class 2.

Insulation Cross linked polyethylene to (XLPE)

Core Colour single core - natural
multi core - Numbered or colour polyster tapes applied over copper tapes

Bedding Extruded PVC

Armour Single core - Non-magnetic (Aluminum) wire / Flat wire
Multi core - Galvanised steel wire / flat wire / Tape

Outer Sheath Extruded PVC / Special PVC compound such as Flame Retardant (FR), Flame Retardant Low Smoke(FRLS), Low Smoke Zero Halogen(LSOH) can be used for outer sheath to suit a variety of environment and fire risk conditions. Flamability test conforms to IEC 60332-1-2 : 2015 . For installation where fire and associated problems such as emission of smoke and toxic fumes offer a serious potential threat, special LSF (Low, smoke & fumes) compound can be provided. LSF compound is Halogen free (Fluorine, Chlorine, Bromine) when tested. The acid gas evolved during combustion is less than 0.5% by weight of material.

Minimum Bending radius - Fixed installation | 12 x Overall diameter



XLPE insulated heavy duty cables were introduced worldwide in mid sixties. These cables have overcome the limitations of PVC Insulated Cables such as thermal degradation, poor moisture resistance and thermoplastic nature.

The advantages of XLPE Insulated cables in comparison to PVC insulated cable are as under:

APPLICATION :

The Cables are suitable for use on AC single phase or three phase systems for rated Voltage up to and including 1100 Volts. These Cables can be used on DC Systems for rated Voltage up to and including 1500 Volts to earth.

A. Commercial Advantages:

Lower installation charges as the diameter of the cable is comparatively lesser with a smaller bending requiring less space requirement for laying cables.

One size lower cable can be used as compared to PVC insulated cable.

Lower laying cost because of the comparatively smaller diameter of cable and higher weight.

B. Technical Advantages:

Higher resistance to moisture.

Better resistance to surge currents.

Higher insulation resistance 1000 times more than PVC cables.

Thermosetting in nature.

Longer service life.

Better resistance to chemicals.

Low dielectric losses.

Comparatively higher cable operation temperature 90°C and short circuit temperature 25°C.

Higher current rating, higher short circuit rating approx. 1.2 times that of PVC.

Minimum Bending Radius For HT Cables / LV Cables / Single Core Unsheathed.

HT Cables:	Single Core : 20 x D	Multicore : 15 x D
LV Cables:	Single Core : 15 x D	Multicore : 12 x D
Single Core Unsheathed:	Single Core : 8 x D	(Where D = Diameter of cable in mm)

Safe Pulling Force With Stockings

- a) For Unarmoured Cable : $P = 5 D^2$ (Where P = Pulling force)
- b) For Armoured Cable : $P = 9 D^2$ (Where D = Diameter of cable in mm)

Safe Pulling Force When Pulled With Pulling Eye

- a) For Aluminium Conductors : 30 N / mm²
- b) For Copper Conductor: 50 N / mm²

HIGHER ELECTRICAL STRENGTH RENTATION

HIGHER SHORT CIRCUIT RATING

BETTER ELECTRICAL, MECHANICAL & THERMAL PROPERTIES

EASY JOINTING AND TERMINATION

Selection of Cables

Power Cables are generally selected considering the application. However following factors are important for selection of suitable cable construction required to transport electrical energy from one end to the other.

Load to be carried.

Fault level.

Maximum operating voltage.

Route length and voltage drop.

Possible overloading duration & magnitude.

Flame retardant properties.

Mode of installation considering installation environment such as ambient & ground temperature as well as chemical & physical properties of soil, Grouping factors, arrangement of Cables during installation.

All sizes of ORBIT XLPE cables are designed for standard operating conditions in India. The standards adopted are after duly considering the geographical / Climactical conditions and general applications of power of utilities, distribution and generation purposes.

The cables are manufactured conforming to Indian & International cables specification for XLPE Insulated cables. Customer specific requirements can also be met.

Basic assumptions

The current rating given as per before mentioned following assumptions

Ambient air temperature: 40°C

Thermal resistivity of soil: 1.5k. m/w

Maximum Conductor temperature: 90°C

Ground temperature: 30°C

Depth of laying (measured to : 750mm)

TECHNICAL DATA

TABLE – 1 “ORBIT” COMPARATIVE CURRENT RATINGS OF 650/1100 VOLTS MULTICORE HEAVY DUTY PVC INSULATED CABLES & XLPE INSULATED CABLES. (3, 3.5 & 4 Core Unarmoured / Armoured PVC Sheathed Cables with Aluminium Conductor.)

Normal Size of Cable	3, 3.5 & 4 Core PVC Insulated & Sheathed Cables			3, 3.5 & 4 Core XLPE Insulated & Sheathed Cables		
	In Ground	In Air	Approx Voltage Drop	In Ground	In Air	Approx Voltage Drop
Sq. mm	Amp	Amp	Mv / anp / mtr	Amp	Amp	Mv / anp / mtr
16	61	52	3.96	74	69	4.24
25	78	70	2.49	95	93	2.67
35	94	85	1.80	114	114	1.94
50	111	104	1.34	134	138	1.43
70	136	131	0.93	164	175	0.99
95	163	162	0.68	197	216	0.72
120	185	186	0.54	223	249	0.58
150	206	212	0.45	249	284	0.48
185	234	245	0.36	282	329	0.39
240	271	291	0.29	327	392	0.31
300	305	335	0.25	369	452	0.26
400	348	390	0.21	420	526	0.21

TABLE – 2 “ORBIT” CONDUCTOR TECHNICAL INFORMATION FOR SINGLE CORE AND MULTICORE CABLES COPPER & ALUMINIUM CONDUCTORS.

Nominal Size of Conductor	Minimum no. of wires				Max D.C. Resistance at 20°C	
	Non Compacted		Compacted Round / Shaped		Plain Copper	Aluminium
Sq.mm	CU	ALU	CU	ALU	Ohm/Km	Ohm/Km
1.5*	3	3	-	-	12.10	18.1
2.5*	3	3	-	-	7.41	12.1
4*	7	3	-	-	4.61	7.41
6*	7	3	-	-	3.08	4.61
10*	7	7	6	-	1.83	3.08
16	7	7	6	6	1.15	1.91
25	7	7	6	6	0.727	1.20
35	7	7	6	6	0.524	0.868
50	19	19	6	6	0.387	0.641
70	19	19	12	12	0.268	0.443
95	19	19	15	15	0.193	0.32
120	37	37	18	15	0.153	0.253
150	37	37	18	15	0.124	0.206
185	37	37	30	30	0.0991	0.164
240	61	37	34	30	0.0754	0.125
300	61	61	34	30	0.0601	0.100
400	61	61	53	53	0.047	0.0778
500	61	61	53	53	0.0366	0.0605
630	91	91	53	53	0.0283	0.0469

TABLE – 3 “ORBIT” SINGLE CORE ALUMINIUM CONDUCTOR , XLPE INSULATED,
UNARMoured & ARMoured CABLES CONFIRMING TO IS 7098 (PART 1)

Nominal Size of Conductor	Form Conductor Circular	Nominal Thickness of XLPE Insulation For U/A	Minimum Thickness of PVC Inner Sheath	Unarmoured Cable			Nominal Thickness Of XLPE Insulation For Armoured Cable	Round Wire Armoured Cable				Formed wire / Strip Armoured Cable				Current Rating.*		*Normal Delivery Length
				Nominal Thickness of PVC Outer Sheath	Approx. Overall Diameter of Cable	Approx. Weight of Cable		Nominal Dimension of Aluminium Round Wire	Minimum Thickness of PVC Outer Sheath	Approx. Overall Diameter of Cable	Approx. Weight of Cable	Nominal Dimension of Aluminium Flat Strip	Minimum Thickness of PVC Outer Sheath	Approx. Overall Diameter of Cable	Approx. Weight of Cable	In Ground	In Air	
Sq.mm	mm	mm	mm	mm	mm	Kgs./Km	mm	mm	mm	mm	Kgs./Km	mm	mm	mm	Kgs./Km	Amps.	Amps.	Mtrs.
4	Solid	0.70	-NA-	1.80	7.50	60	-	-	-	-	-	-	-	-	-	43	38	1000
4	Stranded	0.70	-NA-	1.80	8	65	-	-	-	-	-	-	-	-	-	43	38	1000
6	Solid	0.70	-NA-	1.80	8	70	-	-	-	-	-	-	-	-	-	55	50	1000
6	Stranded	0.70	-NA-	1.80	8.50	75	-	-	-	-	-	-	-	-	-	55	50	1000
10	Solid	0.70	-NA-	1.80	9	80	1	-	-	-	-	-	-	-	-	69	64	1000
10	Stranded	0.70	-NA-	1.80	9.50	90	1	-	-	-	-	-	-	-	-	69	64	1000
16	Stranded	0.70	-NA-	1.80	10	115	1	1.40	1.24	12.5	190	-	-	-	-	89	84	1000
25	Stranded	0.90	-NA-	1.80	12	155	1.20	1.40	1.24	14	247	-	-	-	-	115	112	1000
35	Stranded	0.90	-NA-	1.80	13	180	1.20	1.40	1.24	15	290	-	-	-	-	137	137	1000
50	Stranded	1	-NA-	1.80	14	240	1.30	1.40	1.24	16.5	342	-	-	-	-	161	165	1000
70	Stranded	1.10	-NA-	1.80	15.5	310	1.40	1.40	1.24	18.5	428	-	-	-	-	198	209	1000
95	Stranded	1.10	-NA-	1.80	17.50	385	1.40	1.60	1.40	20.20	560	4 x 0.80	1.40	18.60	494	243	264	1000
120	Stranded	1.20	-NA-	1.80	19.5	470	1.50	1.60	1.40	22.50	665	4 x 0.80	1.40	20.40	589	276	308	1000
150	Stranded	1.40	-NA-	2	21.50	600	1.70	1.60	1.40	24.0	779	4 x 0.80	1.40	22.50	694	308	350	1000
185	Stranded	1.60	-NA-	2	23.50	710	1.90	1.60	1.40	26.50	921	4 x 0.80	1.40	24.50	827	349	406	1000
240	Stranded	1.70	-NA-	2	26	900	2	1.60	1.40	29	1121	4 x 0.80	1.40	26.60	1026	404	480	1000
300	Stranded	1.80	-NA-	2	28.50	1158	2.10	1.60	1.56	31.50	1349	4 x 0.80	1.56	29.60	1235	454	551	1000
400	Stranded	2	-NA-	2.20	31.5	1385	2.40	2	1.56	35.50	1739	4 x 0.80	1.56	33.00	1548.5	518	647	500
500	Stranded	2.20	-NA-	2.20	35.5	1650	2.60	2	1.56	39.50	2128	4 x 0.80	1.56	36.70	1909.5	588	751	500
630	Stranded	2.40	-NA	2.20	39.5	2100	2.80	2	1.72	43	2660	4 x 0.80	1.72	40.50	2413	663	868	500

TABLE – 4 “ORBIT” SINGLE CORE COPPER CONDUCTOR, XLPE INSULATED,
UNARMoured & ARMoured CABLES CONFIRMING TO IS 7098 (PART 1)

Nominal Size of Conductor	Form Conductor Circular	Nominal Thickness of XLPE Insulation For U/A	Minimum Thickness of PVC Inner Sheath	Unarmoured Cable			Nominal Thickness Of XLPE Insulation For Armoured Cable	Round Wire Armoured Cable				Formed wire / Strip Armoured Cable				Current Rating.*		*Normal Delivery Length
				Nominal Thickness of PVC Outer Sheath	Approx. Overall Diameter of Cable	Approx. Weight of Cable		Nominal Dimension of GI Round Strip	Minimum Thickness of PVC Outer Sheath	Approx. Overall Diameter of Cable	Approx. Weight of Cable	Nominal Dimension of Aluminium Flat Strip	Minimum Thickness of PVC Outer Sheath	Approx. Overall Diameter of Cable	Approx. Weight of Cable	In Ground	In Air	
Sq.mm	mm	mm	mm	mm	mm	Kgs./Km	mm	mm	mm	mm	Kgs./Km	mm	mm	mm	Kgs./Km	Amps.	Amps.	Mtrs.
4	Solid	0.70	-NA-	1.80	7.50	85.5	-	-	-	-	-	-	-	-	-	54	48	1000
4	Stranded	0.70	-NA-	1.80	8	88	-	-	-	-	-	-	-	-	-	54	48	1000
6	Solid	0.70	-NA-	1.80	8	109	-	-	-	-	-	-	-	-	-	67	61	1000
6	Stranded	0.70	-NA-	1.80	8.50	114	-	-	-	-	-	-	-	-	-	67	61	1000
10	Stranded	0.70	-NA-	1.80	9.50	152	1	1.40	1.24	12	219	-	-	-	-	90	83	1000
16	Stranded	0.70	-NA-	1.80	10	209	1	1.40	1.24	13	281	-	-	-	-	115	108	1000
25	Stranded	0.90	-NA-	1.80	12	309	1.20	1.40	1.24	14	390	-	-	-	-	148	144	1000
35	Stranded	0.90	-NA-	1.80	13	399	1.20	1.40	1.24	16	485	-	-	-	-	177	176	1000
50	Stranded	1	-NA-	1.80	14	513	1.30	1.40	1.24	17	608	-	-	-	-	208	212	1000
70	Stranded	1.10	-NA-	1.80	16	712	1.40	1.40	1.24	19	817	-	-	-	-	255	269	1000
95	Stranded	1.10	-NA-	1.80	17.50	940	1.40	1.60	1.40	22	1102	4 x 0.80	1.40	18.60	1036	312	340	1000
120	Stranded	1.20	-NA-	1.80	19	1168	1.50	1.60	1.40	23.50	1339	4 x 0.80	1.40	20.40	1264	355	396	1000
150	Stranded	1.40	-NA-	2	21.50	1444	1.70	1.60	1.40	24.50	1615	4 x 0.80	1.40	22.20	1530	396	450	1000
185	Stranded	1.60	-NA-	2	23.50	1786	1.90	1.60	1.40	26.50	1976	4 x 0.80	1.40	24.40	1890	447	519	1000
240	Stranded	1.70	-NA-	2	26	2299	2	1.60	1.40	29	2508	4 x 0.80	1.40	26.60	2404	515	613	1000
300	Stranded	1.80	-NA-	2	28.50	2840.5	2.10	1.60	1.56	31.50	3078	4 x 0.80	1.56	29.60	2974	576	700	500
400	Stranded	2	-NA-	2.20	33	3629	2.40	2	1.56	36.00	3962	4 x 0.80	1.56	33.20	3762	651	813	500
500	Stranded	2.20	-NA-	2.20	36	4598	2.60	2	1.56	39.50	4969	4 x 0.80	1.56	36.70	4770	727	930	500
630	Stranded	2.40	-NA-	2.20	40	5880	2.80	2	1.72	43	6318	4 x 0.80	1.72	41.20	6070	806	1056	500

TABLE – 5 “ORBIT” TWO CORE ALUMINIUM CONDUCTOR, XLPE INSULATED,
UNARMoured & ARMoured CABLES CONFIRMING TO IS 7098 (PART 1)

Nominal Size of Conductor	Form Conductor Circular	Nominal Thickness of XLPE Insulation For U/A	Minimum Thickness of PVC Inner Sheath	Unarmoured Cable			Round Wire Armoured Cable				Formed wire / Strip Armoured Cable				Current Rating		Normal Delivery Length
				Nominal Thickness of PVC Outer Sheath	Approx. Overall Diameter of Cable	Approx. Weight of Cable	Nominal Dimension of Aluminium Round Wire	Minimum Thickness of PVC Outer Sheath	Approx. Overall Diameter of Cable	Approx. Weight of Cable	Nominal Dimension of Aluminium Flat Strip	Minimum Thickness of PVC Outer Sheath	Approx. Overall Diameter of Cable	Approx. Weight of Cable	In Ground	In Air	
Sq.mm	mm	mm	mm	mm	mm	Kgs./Km	mm	mm	mm	Kgs./Km	mm	mm	mm	Kgs./Km	Amps.	Amps.	Mtrs.
4	Solid	0.70	0.30	1.80	12.50	140	1.40	1.24	14.50	375.00	-NA-	-NA-	-NA-	-NA-	42	38	1000
4	Stranded	0.70	0.30	1.80	13	150	1.40	1.24	15.00	403.00	-NA-	-NA-	-NA-	-NA-	42	38	1000
6	Solid	0.70	0.30	1.80	13.50	170	1.40	1.24	15.50	437.00	-NA-	-NA-	-NA-	-NA-	55	50	1000
6	Stranded	0.70	0.30	1.80	14	180	1.40	1.24	16.50	465.00	-NA-	-NA-	-NA-	-NA-	55	50	1000
10	Solid	0.70	0.30	1.80	15	205	1.40	1.24	16	503.00	-NA-	-NA-	-NA-	-NA-	68	64	1000
10	Stranded	0.70	0.30	1.80	16	225	1.40	1.24	18	551.00	-NA-	-NA-	-NA-	-NA-	68	64	1000
16	Stranded	0.70	0.30	1.80	14	225	1.40	1.40	17	480.16	-NA-	-NA-	-NA-	-NA-	89	83	1000
25	Stranded	0.90	0.30	2	17	330	1.60	1.40	20	671.84	4 x 0.80	1.40	18.50	509.13	114	109	1000
35	Stranded	0.90	0.30	2	19	410	1.60	1.40	22	775.55	4 x 0.80	1.40	20	605.51	136	133	1000
50	Stranded	1	0.30	2	21	510	1.60	1.40	24	937.97	4 x 0.80	1.40	22.50	753.28	161	162	1000
70	Stranded	1.10	0.30	2	23	675	1.60	1.56	27	1186.85	4 x 0.80	1.56	22.50	989	197	204	1000
95	Stranded	1.10	0.40	2.20	26.50	893	2	1.56	28.68	1572.78	4 x 0.80	1.56	28	1204.30	235	251	1000
120	Stranded	1.20	0.40	2.20	28.50	1050	2	1.56	33	1849.49	4 x 0.80	1.56	30.50	1408.20	266	287	500
150	Stranded	1.40	0.40	2.20	32	1215	2	1.72	36	2182.96	4 x 0.80	1.72	31.79	1690.20	296	328	500
185	Stranded	1.60	0.50	2.40	35.50	1510	2	1.88	37.70	2597.60	4 x 0.80	1.72	34.95	2004.00	335	379	500
240	Stranded	1.70	0.50	2.60	39.50	1900	2.50	2.04	45	3418.52	4 x 0.80	1.88	38.69	2480.00	385	448	500
300	Stranded	1.80	0.60	2.80	43.50	2360	2.50	2.20	46.22	4019.07	4 x 0.80	2.04	42.53	2964.00	432	513	500
400	Stranded	2	0.60	3	49	3100	2.50	2.36	51.61	4854.00	4 x 0.80	2.36	48.24	3676.00	487	593	500
500	Stranded	2.20	0.70	3.40	55.50	4000	3.15	2.68	61.50	6517.00	4 x 0.80	2.52	56.50	4599.00	548	683	500
630	Stranded	2.40	0.70	3.60	61.50	4997	3.15	2.84	67.50	7790.00	4 x 0.80	2.68	62.50	5662.00	612	784	500

TABLE-6 "ORBIT" TWO CORE COPPER CONDUCTOR, XLPE INSULATED,
UNARMoured & ARMoured CABLES CONFIRMING TO IS 7098 (PART 1)

Nominal Size of Conductor	Form Conductor Circular	Nominal Thickness of XLPE Insulation For U/A	Minimum Thickness of PVC Inner Sheath	Unarmoured Cable			Round Wire Armoured Cable				Formed wire / Strip Armoured Cable				Current Rating		Normal Delivery Length
				Nominal Thickness of PVC Outer Sheath	Approx. Overall Diameter of Cable	Approx. Weight of Cable	Nominal Dimension of GI Round Strip	Minimum Thickness of PVC Outer Sheath	Approx. Overall Diameter of Cable	Approx. Weight of Cable	Nominal Dimension of Flat Strip	Minimum Thickness of PVC Outer Sheath	Approx. Overall Diameter of Cable	Approx. Weight of Cable	In Ground	In Air	
Sq.mm	mm	mm	mm	mm	mm	Kgs./Km	mm	mm	mm	Kgs./Km	mm	mm	mm	Kgs./Km	Amps.	Amps.	Mtrs.
4	Solid	0.70	0.30	1.80	12.50	165	1.40	1.24	14.00	408	-NA-	-NA-	-NA-	-NA-	54	48	1000
4	Stranded	0.70	0.30	1.80	13	175	1.40	1.24	14.50	427	-NA-	-NA-	-NA-	-NA-	54	48	1000
6	Solid	0.70	0.30	1.80	13.50	210	1.40	1.24	15.00	484	-NA-	-NA-	-NA-	-NA-	67	61	1000
6	Stranded	0.70	0.30	1.80	14	225	1.40	1.24	16.00	522	-NA-	-NA-	-NA-	-NA-	67	61	1000
10	Stranded	0.70	0.30	1.80	16	300	1.40	1.24	17.50	665	-NA-	-NA-	-NA-	-NA-	89	83	1000
16	Stranded	0.70	0.30	1.80	14	422	1.40	1.40	17	696.50	-NA-	-NA-	-NA-	-NA-	115	108	1000
25	Stranded	0.90	0.30	2	17	636	1.60	1.40	20	1001.70	4 x 0.80	1.40	18.50	804.40	147	140	1000
35	Stranded	0.90	0.30	2	19	817	1.60	1.40	22	1224.20	4 x 0.80	1.40	20	1019.70	176	172	1000
50	Stranded	1	0.30	2	21	1054	1.60	1.40	24	1520.00	4 x 0.80	1.40	22.50	1311.00	208	208	1000
70	Stranded	1.10	0.30	2	23	1453	1.60	1.56	27	2004.00	4 x 0.80	1.56	25.50	1757.00	253	262	1000
95	Stranded	1.10	0.40	2.20	26.50	1966	2	1.56	30.50	2736.00	4 x 0.80	1.56	28	2289.00	302	322	500
120	Stranded	1.20	0.40	2.20	28.50	2413	2	1.56	33	3230.00	4 x 0.80	1.56	30.50	2755.00	340	368	500
150	Stranded	1.40	0.40	2.20	32	2935	2	1.72	36	3876.00	4 x 0.80	1.72	31.80	3353.00	379	419	500
185	Stranded	1.60	0.50	2.40	35.50	3676	2	1.88	40	4731.00	4 x 0.80	1.72	37	4094.00	425	482	500
240	Stranded	1.70	0.50	2.60	39.50	4750	2.50	2.04	42.40	6203.00	4 x 0.80	1.88	38.70	5225.00	486	566	500
300	Stranded	1.80	0.60	2.80	43.50	5918	2.50	2.20	46.20	7514.00	4 x 0.80	2.04	42.50	6412.00	541	644	500
400	Stranded	2	0.60	3	49	7495	2.50	2.36	51.60	9262.00	4 x 0.80	2.36	48.20	8075.00	602	734	500

TABLE-7 "ORBIT" THREE CORE ALUMINIUM CONDUCTOR, XLPE INSULATED,
UNARMoured & ARMoured CABLES CONFIRMING TO IS 7098 (PART 1)

Nominal Size of Conductor	Form of Conductor Circular shaped	Nominal Thickness of XLPE Insulation	Minimum Thickness of PVC Inner Sheath	Unarmoured Cable			Round Wire Armoured Cable				Formed wire / Strip Armoured Cable				Current Rating		Normal Delivery Length
				Nominal Thickness of PVC Outer Sheath	Approx. Overall Diameter of Cable	Approx. Weight of Cable	Nominal Dimension of Aluminium Round Wire	Minimum Thickness of PVC Outer Sheath	Approx. Overall Diameter of Cable	Approx. Weight of Cable	Nominal Dimension of GL Flat Strip	Minimum Thickness of PVC Outer Sheath	Approx. Overall Diameter of Cable	Approx. Weight of Cable	In Ground	In Air	
Sq.mm	mm	mm	mm	mm	mm	Kgs./Km	mm	mm	mm	Kgs./Km	mm	mm	mm	Kgs./Km	Amps.	Amps.	Mtrs.
4	Solid	0.70	0.30	1.80	13	140	1.40	1.24	15	460	-NA-	-NA-	-NA-	-NA-	35	32	1000
4	Stranded	0.70	0.30	1.80	13.50	160	1.40	1.24	16	399	-NA-	-NA-	-NA-	-NA-	35	32	1000
6	Solid	0.70	0.30	1.80	14.50	170	1.40	1.24	16	530	-NA-	-NA-	-NA-	-NA-	46	42	1000
6	Stranded	0.70	0.30	1.80	15	190	1.40	1.24	17	470	-NA-	-NA-	-NA-	-NA-	46	42	1000
10	Solid	0.70	0.30	1.80	15.50	220	1.40	1.24	18	640	-NA-	-NA-	-NA-	-NA-	57	54	1000
10	Stranded	0.70	0.30	1.80	17	230	1.40	1.24	18.50	551	-NA-	-NA-	-NA-	-NA-	57	54	1000
16	Stranded	0.70	0.30	1.80	16.20	304	1.60	1.40	19	648.40	4 x 0.80	1.24	16.80	487.60	74	69	1000
25	Stranded	0.90	0.30	2	19.50	446	1.60	1.40	21.70	855.00	4 x 0.80	1.40	20.10	670.70	95	93	1000
35	Stranded	0.90	0.30	2	21.50	551	1.60	1.40	23.60	997.00	4 x 0.80	1.40	22	798.00	114	114	1000
50	Stranded	1	0.30	2	24.50	693	1.60	1.56	26.80	1235.00	4 x 0.80	1.40	24.80	960.00	134	138	1000
70	Stranded	1.10	0.40	2.20	28	950	2	1.56	30.90	1729.00	4 x 0.80	1.56	28.50	1282	164	175	500
95	Stranded	1.10	0.40	2.20	30.80	1206	2	1.56	33.70	2077.00	4 x 0.80	1.56	31.30	1577	197	216	500
120	Stranded	1.20	0.40	2.20	33.80	1463	2	1.72	37	2422.00	4 x 0.80	1.56	34.30	1871	223	249	500
150	Stranded	1.40	0.50	2.40	37.90	1814	2	1.88	41.10	2888.00	4 x 0.80	1.72	38.30	2100	249	284	500
185	Stranded	1.60	0.50	2.60	42	2242	2.50	2.04	46	3733.00	4 x 0.80	1.88	42.30	2500	282	329	500
240	Stranded	1.70	0.60	2.80	46.90	2869	2.50	2.20	50.90	4531.00	4 x 0.80	2.04	47.20	3382	327	392	500
300	Stranded	1.80	0.60	3	51.50	3505	2.50	2.36	55.45	5339.00	4 x 0.80	2.20	51.80	4066	369	452	500
400	Stranded	2	0.70	3.20	58.60	4427	3.15	2.68	64	7115.00	4 x 0.80	2.52	58.50	5101	420	526	500
500	Stranded	2.20	0.70	3.60	66	5681	3.15	2.84	73	8597.00	4 x 0.80	2.68	65	6365	478	612	250
630	Stranded	2.40	0.70	3.80	72	7125	4	3	78	11295	4 x 0.80	2.84	73	7894	542	712	250

TABLE-8 "ORBIT" THREE CORE COPPER CONDUCTOR, XLPE INSULATED,
UNARMoured & ARMoured CABLES CONFIRMING TO IS 7098 (PART 1)

Nominal Size of Conductor	Form Conductor Circular Shaped	Nominal Thickness of XLPE Insulation	Minimum Thickness of PVC Inner Sheath	Unarmoured Cable			Round Wire Armoured Cable				Formed wire / Strip Armoured Cable				Current Rating		Normal Delivery Length
				Nominal Thickness of PVC Outer Sheath	Approx. Overall Diameter of Cable	Approx. Weight of Cable	Nominal Dimension of GI Round Strip	Minimum Thickness of PVC Outer Sheath	Approx. Overall Diameter of Cable	Approx. Weight of Cable	Nominal Dimension of GI Flat Strip	Minimum Thickness of PVC Outer Sheath	Approx. Overall Diameter of Cable	Approx. Weight of Cable	In Ground	In Air	
Sq.mm	mm	mm	mm	mm	mm	Kgs./Km	mm	mm	mm	Kgs./Km	mm	mm	mm	Kgs./Km	Amps.	Amps.	Mtrs.
4	Solid	0.70	0.30	1.80	13.00	210	1.40	1.24	15	530	-NA-	-NA-	-NA-	-NA-	45	41	1000
4	Stranded	0.70	0.30	1.80	13.50	232	1.40	1.24	16	460	-NA-	-NA-	-NA-	-NA-	45	41	1000
6	Solid	0.70	0.30	1.80	14.00	280	1.40	1.24	16	640	-NA-	-NA-	-NA-	-NA-	56	52	1000
6	Stranded	0.70	0.30	1.80	15.00	299	1.40	1.24	17	551	-NA-	-NA-	-NA-	-NA-	56	52	1000
10	Stranded	0.70	0.30	1.80	16.50	415	1.40	1.24	19	722	-NA-	-NA-	-NA-	-NA-	74	70	1000
16	Stranded	0.70	0.30	1.80	16.20	425	1.60	1.40	18.80	921	4 x 0.80	1.24	16.80	772.30	95	89	1000
25	Stranded	0.90	0.30	2	19.50	874	1.60	1.40	21.70	1282	4 x 0.80	1.40	20.10	1102	122	119	1000
35	Stranded	0.90	0.30	2	21.50	1150	1.60	1.40	23.60	1596	4 x 0.80	1.40	22	1396	146	147	1000
50	Stranded	1	0.30	2	24.50	1501	1.60	1.56	26.80	2042	4 x 0.80	1.40	24.80	1767	173	179	1000
70	Stranded	1.10	0.40	2.20	28.00	2118	2	1.56	30.90	2888	4 x 0.80	1.56	28.50	2441	212	226	500
95	Stranded	1.10	0.40	2.20	30.80	2821	2	1.56	33.70	3686	4 x 0.80	1.56	31.30	3182	254	279	500
120	Stranded	1.20	0.40	2.20	33.80	3496	2	1.72	37	4455	4 x 0.80	1.56	34.30	3895	287	320	500
150	Stranded	1.40	0.50	2.40	37.90	4322	2	1.88	41.10	5396	4 x 0.80	1.72	38.30	4759	321	365	500
185	Stranded	1.60	0.50	2.60	42	5377	2.50	2.04	46	6868	4 x 0.80	1.88	42.30	5852	362	422	500
240	Stranded	1.70	0.60	2.80	46.90	6992	2.50	2.20	50.90	8654	4 x 0.80	2.04	47.20	7505	418	500	500
300	Stranded	1.80	0.60	3	51.50	8683	2.50	2.36	55.50	10526	4 x 0.80	2.20	51.80	9243	469	574	500
400	Stranded	2	0.70	3.20	58.60	11029	3.15	2.68	64	13718	4 x 0.80	2.52	58.50	11704	528	662	250

TABLE-9 "ORBIT" THREE AND HALF CORE ALUMINIUM CONDUCTOR, XLPE INSULATED,
UNARMoured & ARMoured CABLES CONFIRMING TO IS 7098 (PART 1)

Nominal Size of Conductor	Form of Conductor Circular shaped	Nominal Thickness of XLPE Insulation	Minimum Thickness of PVC Inner Sheath	Unarmoured Cable			Round Wire Armoured Cable				Formed wire / Strip Armoured Cable				Current Rating		Normal Delivery Length
				Nominal Thickness of PVC Outer Sheath	Approx. Overall Diameter of Cable	Approx. Weight of Cable	Nominal Dimension of GL Round Strip	Minimum Thickness of PVC Outer Sheath	Approx. Overall Diameter of Cable	Approx. Weight of Cable	Nominal Dimension of GL Flat Strip	Minimum Thickness of PVC Outer Sheath	Approx. Overall Diameter of Cable	Approx. Weight of Cable	In Ground	In Air	
Sq.mm	mm	mm	mm	mm	mm	Kgs./Km	mm	mm	mm	Kgs./Km	mm	mm	mm	Kgs./Km	Amps.	Amps.	Mtrs.
25/16	Stranded	0.90 0.70	0.30	2	21.30	525	1.6	1.4	23.6	969	4 x 0.80	21.90	21.90	733	95	93	1000
35/16	Stranded	0.90 0.70	0.30	2	23.60	625	1.6	1.4	25.8	1139	4 x 0.80	24.20	24.20	886	114	114	1000
50/25	Stranded	1 0.90	0.30	2	26.80	800	1.6	1.56	29.5	1387	4 x 0.80	27.40	27.40	1113	134	138	1000
70/35	Stranded	1.10 0.90	0.40	2.20	31	1100	2	1.56	34	1938	4 x 0.80	31.50	31.50	1451	164	175	500
95/50	Stranded	1.10 1	0.40	2.20	34.30	1400	2	1.56	37.2	2356	4 x 0.80	34.80	34.80	1796	197	216	500
120/70	Stranded	1.20 1.10	0.40	2.20	37.50	1650	2	1.72	41	2800	4 x 0.80	38.50	38.50	2199	223	249	500
150/70	Stranded	1.40 1.10	0.50	2.40	41	2000	2	1.88	45	3296	4 x 0.80	42	42	2579	249	284	500
185/95	Stranded	1.60 1.10	0.50	2.60	46.50	2550	2.5	2.04	50	4313	4 x 0.80	47.20	47.20	3156	282	329	500
240/120	Stranded	1.70 1.20	0.60	2.80	52.50	3200	2.5	2.2	56	5196	4 x 0.80	52.70	52.70	3913	327	392	500
300/150	Stranded	1.80 1.40	0.60	3	56	4000	2.5	2.36	61	6108	4 x 0.80	57	57	4693	369	452	500
400/185	Stranded	2 1.60	0.70	3.40	64	5177	3.15	2.68	70	8151	4 x 0.80	65	65	5890	420	526	500
500/240	Stranded	2.20 1.70	0.70	3.60	72.50	6500	3.15	2.84	77	9880	4 x 0.80	73.50	73.50	7400	478	612	250

TABLE-10 "ORBIT" THREE AND HALF CORE COPPER CONDUCTOR, XLPE INSULATED,
UNARMoured & ARMoured CABLES CONFIRMING TO IS 7098 (PART 1)

Nominal Size of Conductor	Form of Conductor Circular shaped	Nominal Thickness of XLPE Insulation	Minimum Thickness of PVC Inner Sheath	Unarmoured Cable			Round Wire Armoured Cable				Formed wire / Strip Armoured Cable				Current Rating		Normal Delivery Length
				Nominal Thickness of PVC Outer Sheath	Approx. Overall Diameter of Cable	Approx. Weight of Cable	Nominal Dimension of GL Round Strip	Minimum Thickness of PVC Outer Sheath	Approx. Overall Diameter of Cable	Approx. Weight of Cable	Nominal Dimension of GL Flat Strip	Minimum Thickness of PVC Outer Sheath	Approx. Overall Diameter of Cable	Approx. Weight of Cable	In Ground	In Air	
Sq.mm	mm	mm	mm	mm	mm	Kgs./Km	mm	mm	mm	Kgs./Km	mm	mm	mm	Kgs./Km	Amps.	Amps.	Mtrs.
25/16	Stranded	0.90 0.70	0.30	2	21.30	1035	1.6	1.4	23.6	1491	4x0.80	1.40	21.90	1272	122	119	1000
35/16	Stranded	0.90 0.70	0.30	2	23.60	1311	1.6	1.4	25.8	1824	4x0.80	1.40	24.20	1586	146	147	1000
50/25	Stranded	1 0.90	0.30	2	26.80	1748	1.6	1.56	29	2337	4x0.80	1.40	27.40	2061	173	179	1000
70/35	Stranded	1.10 0.90	0.40	2.20	31	2460	2	1.56	33.9	3296	4x0.80	1.56	31.50	2831	212	226	500
95/50	Stranded	1.10 1	0.40	2.20	34.30	3287	2	1.56	37.2	4237	4x0.80	1.56	34.80	3686	254	279	500
120/70	Stranded	1.20 1.10	0.40	2.20	37.60	4142	2	1.72	41	5225	4x0.80	1.72	38.50	4617	287	320	500
150/70	Stranded	1.40 1.10	0.50	2.40	42.30	4987	2	1.88	45	6194	4x0.80	1.72	42.70	5481	321	365	500
185/95	Stranded	1.60 1.10	0.50	2.60	46.80	6279	2.5	2.04	50	7989	4x0.80	1.88	47.20	6830	362	422	500
240/120	Stranded	1.70 1.20	0.60	2.80	52.40	8122	2.5	2.2	56	10003	4x0.80	2.04	52.70	8711	418	500	500
300/150	Stranded	1.80 1.40	0.60	3	57	10079	2.5	2.36	61	12131	4x0.80	2.20	57.90	10716	469	574	500
400/185	Stranded	2 1.60	0.70	3.40	65	12834.5	3.15	2.68	70	15817	4x0.80	2.52	65.50	13556	528	662	250

TABLE-II "ORBIT" FOUR CORE ALUMINIUM CONDUCTOR, XLPE INSULATED,
UNARMoured & ARMoured CABLES CONFIRMING TO IS 7098 (PART 1)

Nominal cross sectional area	Nominal Thickness of pvc Insulation	Nominal Thickness of Inner Sheath	Minimum Thickness of PVC Inner Sheath	Unarmoured Cable			Round Wire Armoured Cable				Formed wire / Strip Armoured Cable				Current Rating		Normal Delivery Length
				Nominal Thickness of PVC Outer Sheath	Approx. Overall Diameter of Cable	Approx. Weight of Cable	Nominal Dimension of Aluminium Round Wire	Minimum Thickness of PVC Outer Sheath	Approx. Overall Diameter of Cable	Approx. Weight of Cable	Nominal Dimension of GL Flat Strip	Minimum Thickness of PVC Outer Sheath	Approx. Overall Diameter of Cable	Approx. Weight of Cable	In Ground	In Air	
Sq.mm	mm	mm	mm	mm	mm	Kgs./Km	mm	mm	mm	Kgs./Km	mm	mm	mm	Kgs./Km	Amps.	Amps.	Mtrs.
4	Solid	0.70	0.30	1.80	13.50	160	1.40	1.24	15.30	413	-NA-	-NA-	-NA-	-NA-	35	32	1000
4	Stranded	0.70	0.30	1.80	14.20	180	1.40	1.24	16	435	-NA-	-NA-	-NA-	-NA-	35	32	1000
6	Solid	0.70	0.30	1.80	14.70	200	1.40	1.24	16.50	473	-NA-	-NA-	-NA-	-NA-	46	42	1000
6	Stranded	0.70	0.30	1.80	15.50	215	1.40	1.24	17.30	506	-NA-	-NA-	-NA-	-NA-	46	42	1000
10	Solid	0.70	0.30	1.80	16.60	250	1.40	1.40	18.60	592	-NA-	-NA-	-NA-	-NA-	57	54	1000
10	Stranded	0.70	0.30	1.80	17.50	260	1.40	1.40	19.80	633	-NA-	-NA-	-NA-	-NA-	57	54	1000
16	Stranded	0.70	0.30	1.80	17.80	350	1.60	1.40	21	795	4x0.80	1.40	20	608	74	69	1000
25	Stranded	0.90	0.30	2	21	550	1.60	1.40	25	1045	4x0.80	1.40	23	828.50	95	93	500
35	Stranded	0.90	0.30	2	23.50	680	1.60	1.40	26.50	1244	4x0.80	1.40	25	997	114	114	500
50	Stranded	1	0.30	2	26	875	1.60	1.56	29.50	1520	4x0.80	1.56	28	1235	134	138	500
70	Stranded	1.10	0.40	2.20	30.50	1200	2	1.56	34	2137	4x0.80	1.56	32	1615	164	175	500
95	Stranded	1.10	0.40	2.20	33.50	1530	2	1.72	38	2622	4x0.80	1.56	35	2014	197	216	500
120	Stranded	1.20	0.50	2.40	37.50	1850	2	1.88	42	3087	4x0.80	1.72	39	2403	223	249	500
150	Stranded	1.40	0.50	2.60	42	2280	2.50	2.04	47	3980	4x0.80	1.88	43	2888	249	284	500
185	Stranded	1.60	0.50	2.80	46.50	2800	2.50	2.20	52	4721	4x0.80	2.04	48	3505	282	329	500
240	Stranded	1.70	0.60	3	52.50	3700	2.50	2.36	57.50	5709	4x0.80	2.20	54	4389	327	392	500
300	Stranded	1.80	0.70	3.20	58	4600	3.15	2.52	64.50	7372	4x0.80	2.36	59.50	5291	369	452	500
400	Stranded	2	0.70	3.60	65.50	6000	3.15	2.84	71.50	8985	4x0.80	2.68	66.50	6583	420	526	500

TABLE-12 "ORBIT" FOUR CORE, COPPER CONDUCTOR, XLPE INSULATED

UNARMoured & ARMoured CABLES CONFIRMING TO IS 7098 (PART 1)

Nominal Size of Conductor	Form Conductor Circular Shaped	Nominal Thickness of XLPE Insulation	Minimum Thickness of PVC Inner Sheath	Unarmoured Cable			Round Wire Armoured Cable				Formed wire / Strip Armoured Cable				Current Rating		Normal Delivery Length
				Nominal Thickness of PVC Outer Sheath	Approx. Overall Diameter of Cable	Approx. Weight of Cable	Nominal Dimension of GI Round Strip	Minimum Thickness of PVC Outer Sheath	Approx. Overall Diameter of Cable	Approx. Weight of Cable	Nominal Dimension of GL Flat Strip	Minimum Thickness of PVC Outer Sheath	Approx. Overall Diameter of Cable	Approx. Weight of Cable	In Ground	In Air	
Sq.mm	mm	mm	mm	mm	mm	Kgs./Km	mm	mm	mm	Kgs./Km	mm	mm	mm	Kgs./Km	Amps.	Amps.	Mtrs.
4	Solid	0.70	0.30	1.80	13.50	260	1.40	1.24	15.30	503	-NA-	-NA-	-NA-	-NA-	45	41	1000
4	Stranded	0.70	0.30	1.80	14.20	280	1.40	1.24	16	533	-NA-	-NA-	-NA-	-NA-	45	41	1000
6	Solid	0.70	0.30	1.80	14.70	350	1.40	1.24	16.50	618	-NA-	-NA-	-NA-	-NA-	56	52	1000
6	Stranded	0.70	0.30	1.80	15.50	365	1.40	1.24	17.30	646	-NA-	-NA-	-NA-	-NA-	56	52	1000
10	Stranded	0.70	0.30	1.80	17.80	510	1.40	1.40	19.80	870	-NA-	-NA-	-NA-	-NA-	74	70	1000
16	Stranded	0.70	0.30	1.80	17.50	741	1.60	1.40	21	1159	4x0.80	1.40	20	969	95	89	1000
25	Stranded	0.90	0.30	2	21	1140	1.60	1.40	25	1615	4x0.80	1.40	23	1406	122	119	500
35	Stranded	0.90	0.30	2	23.50	1491	1.60	1.40	26.50	2033	4x0.80	1.40	25	1786	146	147	500
50	Stranded	1	0.30	2	26	1957	1.60	1.56	29.50	2593	4x0.80	1.56	28	2308	173	179	500
70	Stranded	1.10	0.40	2.20	30.50	2774	2	1.56	34	3686	4x0.80	1.56	32	3154	212	226	500
95	Stranded	1.10	0.40	2.20	33.50	3714	2	1.72	38	4769	4x0.80	1.56	35	4161	254	279	500
120	Stranded	1.20	0.50	2.40	37.50	4645	2	1.88	42	5795	4x0.80	1.72	39	5101	287	320	500
150	Stranded	1.40	0.50	2.60	42	5719	2.50	2.04	47	7324	4x0.80	1.88	43.50	6232	321	365	500
185	Stranded	1.60	0.50	2.80	46.50	7125	2.50	2.20	52	8901	4x0.80	2.04	48	7676	362	422	500
240	Stranded	1.70	0.60	3	52.50	9253	2.50	2.36	57.50	11210	4x0.80	2.20	54	9880	418	500	500
300	Stranded	1.80	0.70	3.20	58	11524	3.15	2.52	64.50	14279	4x0.80	2.36	59.50	12198	469	574	500

TABLE-13 "ORBIT" 650 / 1100 VOLTS MULTI CORE CONTROL CABLES WITH SOLID COPPER CONDUCTOR OF SIZE 1.5 SQ.MM XLPE INSULATED

UNARMoured & ARMoured CABLES CONFIRMING TO IS 7098 (PART 1)

Nominal Size of Conductor	Nominal Thickness of XLPE Insulation	Minimum Thickness of PVC Inner Sheath	Unarmoured Cable			Round Wire Armoured Cable				Formed wire / Strip Armoured Cable				Current Rating		Normal Delivery Length
			Nominal Thickness of PVC Outer Sheath	Approx. Overall Diameter of Cable	Approx. Weight of Cable	Nominal Dimension of Aluminium Round Wire	Minimum Thickness of PVC Outer Sheath	Approx. Overall Diameter of Cable	Approx. Weight of Cable	Nominal Dimension of GL Flat Strip	Minimum Thickness of PVC Outer Sheath	Approx. Overall Diameter of Cable	Approx. Weight of Cable	In Ground	In Air	
Sq.mm	mm	mm	mm	mm	Kgs./Km	mm	mm	mm	Kgs./Km	mm	mm	mm	Kgs./Km	Amps.	Amps.	Mtrs.
2	0.70	0.30	1.80	10	140	1.40	1.24	11.90	288	-NA-	-NA-	-NA-	-NA-	31	27	1000
3	0.70	0.30	1.80	10.50	160	1.40	1.24	12.40	302	-NA-	-NA-	-NA-	-NA-	26	23	1000
4	0.70	0.30	1.80	11.50	171	1.40	1.24	13.10	349	-NA-	-NA-	-NA-	-NA-	26	23	1000
5	0.70	0.30	1.80	12.10	195	1.40	1.24	13.90	385	-NA-	-NA-	-NA-	-NA-	26	23	1000
6	0.70	0.30	1.80	12.90	222	1.40	1.24	14.70	432	-NA-	-NA-	-NA-	-NA-	23	20	1000
7	0.70	0.30	1.80	12.90	239	1.40	1.24	14.70	450	-NA-	-NA-	-NA-	-NA-	20	18	1000
8	0.70	0.30	1.80	14	275	1.40	1.24	16.50	494	-NA-	-NA-	-NA-	-NA-	17	15	1000
9	0.70	0.30	1.80	15	308	1.40	1.24	17.50	542	-NA-	-NA-	-NA-	-NA-	17	15	1000
10	0.70	0.30	1.80	15.70	327	1.40	1.24	17.50	594	-NA-	-NA-	-NA-	-NA-	17	15	1000
12	0.70	0.30	1.80	16.10	365	1.40	1.24	18	646	-NA-	-NA-	-NA-	-NA-	16	14	1000
14	0.70	0.30	1.80	16.80	413	1.40	1.40	18.90	709	-NA-	-NA-	-NA-	-NA-	16	14	1000
16	0.70	0.30	1.80	17.70	460	1.60	1.40	20.10	807	4x0.80	1.40	18.50	651	14	12	1000
19	0.70	0.30	1.80	18.50	513	1.60	1.40	20.90	900	4x0.80	1.40	19.30	736	14	12	1000
21	0.70	0.30	2	19.80	560	1.60	1.40	21.80	960	4X0.80	1.40	20.20	788	12	11	500
24	0.70	0.30	2	21.70	627	1.60	1.40	23.70	1094	4x0.80	1.40	22.10	874	12	11	500
27	0.70	0.30	2	22.10	684	1.60	1.40	24.10	1152	4x0.80	1.40	22.50	950	11	9	500
30	0.70	0.30	2	22.80	741	1.60	1.40	24.90	1229	4x0.80	1.40	23.20	1016	11	9	500
33	0.70	0.30	2	23.70	807	1.60	1.40	25.70	1322	4x0.80	1.40	24.10	1102	11	9	500
37	0.70	0.30	2	24.50	874	1.60	1.40	26.50	1415	4x0.80	1.40	24.90	1168	11	9	500
44	0.70	0.30	2	27.30	1026	1.60	1.56	29.70	1662	4x0.80	1.40	27.70	1358	9	8	500
52	0.70	0.30	2	28.40	1178	1.60	1.56	30.90	1833	4x0.80	1.56	29.20	1548	9	8	500
61	0.70	0.40	2.20	30.70	1387	2	1.56	33.50	2251	4x0.80	1.56	31.10	1757	9	8	500

TABLE-14 "ORBIT" 650 / 1100 VOLTS MULTI CORE CONTROL CABLES WITH SOLID COPPER CONDUCTOR OF SIZE 2.5 SQ.MM XLPE INSULATED

UNARMoured & ARMoured CABLES CONFIRMING TO IS 7098 (PART 1)

Nominal Size of Conductor	Nominal Thickness of XLPE Insulation	Minimum Thickness of PVC Inner Sheath	Unarmoured Cable			Round Wire Armoured Cable				Formed wire / Strip Armoured Cable				Current Rating		Normal Delivery Length
			Nominal Thickness of PVC Outer Sheath	Approx. Overall Diameter of Cable	Approx. Weight of Cable	Nominal Dimension of Aluminium Round Wire	Minimum Thickness of PVC Outer Sheath	Approx. Overall Diameter of Cable	Approx. Weight of Cable	Nominal Dimension of GL Flat Strip	Minimum Thickness of PVC Outer Sheath	Approx. Overall Diameter of Cable	Approx. Weight of Cable	In Ground	In Air	
Sq.mm	mm	mm	mm	mm	Kgs./Km	mm	mm	mm	Kgs./Km	mm	mm	mm	Kgs./Km	Amps.	Amps.	Mtrs.
2	0.70	0.30	1.80	10.90	173	1.40	1.24	12.70	342	-NA-	-NA-	-NA-	-NA-	41	36	1000
3	0.70	0.30	1.80	11.40	202	1.40	1.24	13.20	360	-NA-	-NA-	-NA-	-NA-	34	30	1000
4	0.70	0.30	1.80	12.20	218	1.40	1.24	14	406	-NA-	-NA-	-NA-	-NA-	34	30	1000
5	0.70	0.30	1.80	13.10	254	1.40	1.24	14.90	464	-NA-	-NA-	-NA-	-NA-	34	30	1000
6	0.70	0.30	1.80	14	291	1.40	1.24	15.90	522	-NA-	-NA-	-NA-	-NA-	31	27	1000
7	0.70	0.30	1.80	14	313	1.40	1.24	15.90	549	-NA-	-NA-	-NA-	-NA-	27	23	1000
8	0.70	0.30	1.80	16	342	1.40	1.24	17	608	-NA-	-NA-	-NA-	-NA-	23	20	1000
9	0.70	0.30	1.80	16.50	385	1.40	1.40	18.50	684	-NA-	-NA-	-NA-	-NA-	23	20	1000
10	0.70	0.30	1.80	17.20	427	1.60	1.40	19.60	789	4x0.80	1.24	17.80	624	23	20	1000
12	0.70	0.30	1.80	17.70	484	1.60	1.40	20.10	865	4x0.80	1.40	18.50	694	20	18	1000
14	0.70	0.30	1.80	18.50	551	1.60	1.40	20.90	944	4x0.80	1.40	19.30	780	20	18	1000
16	0.70	0.30	2	19.80	636	1.60	1.40	21.90	1023	4x0.80	1.40	20.20	867	18	16	1000
19	0.70	0.30	2	20.80	722	1.60	1.40	22.80	1147	4x0.80	1.40	21.20	960	18	16	1000
21	0.70	0.30	2	21.80	769	1.60	1.40	23.90	1243	4x0.80	1.40	22.20	1016	16	14	500
24	0.70	0.30	2	24	864	1.60	1.40	26	1387	4x0.80	1.40	24.40	1159	16	14	500
27	0.70	0.30	2	24.50	950	1.60	1.40	26.50	1482	4x0.80	1.40	24.90	1235	14	13	500
30	0.70	0.30	2	25.30	1035	1.60	1.40	27.30	1586	4x0.80	1.40	25.70	1349	14	13	500
33	0.70	0.30	2	26.20	1130	1.60	1.56	28.60	1729	4x0.80	1.40	26.60	1437	14	13	500
37	0.70	0.30	2	27.20	1235	1.60	1.56	29.60	1852	4x0.80	1.40	27.60	1567	14	13	500
44	0.70	0.40	2.20	30.90	1501	2	1.56	33.70	2356	4x0.80	1.56	31.30	1862	12	11	500
52	0.70	0.40	2.20	32.20	1719	2	1.56	35	2631	4x0.80	1.56	32.60	2109	12	11	500
61	0.70	0.40	2.20	34.10	1976	2	1.56	36.90	2926	4x0.80	1.56	34.50	2375	12	11	500

CABLE HANDLING AND STORAGE

UNREELING (CABLE PULLING) :

For unreeling cable from a drum it should be mounted on cable jack. The drum should be lifted above the ground with clearance of 50-100 mm so that while unreeling the drum flanges should not touch the ground and get damaged. The drum should never be kept flat on its side on the ground and the cable unreeled in coil from the same. This invariably leads kinking and bird-caging.

“Bird-Caging” is a defect caused due to twist of cable during wrong unreeling. It results outer sheath crack or cuts and armour swelling.

Photograph of birdcaging.



The technique of pulling cables is also an important, Sub-standard and haphazard handling can cause damage to the cable which may weaken the cable components, and cause a failure in due course. Care must be taken to select a suitable position for the cable drum jacks in order to ensure that the drum may be raised and rotated with full safety.

The jacks should therefore be placed on a firm support of thick boards.

Care should be taken to exert a steady pull avoiding any jerks. Twisting or kinking of cable is very dangerous as this may cause damage to the small size of cable conductors, insulation and sheath, shifting and knife-edging of the armouring and damage to the serving, etc. Care should be taken to avoid short bends and consequent straining of conductors.

Proper handling of cables is very important both for safety as well as long life of the installation.

The most common causes of cable failure are due to mishandling of the product at installation stage.

This can be prevented by unwinding the cable by loading the drum on jacks & pulling in the proper direction with stocking or pulling eye.

For pulling longer lengths and higher diameter of cables Pulling Eyes can be used...

In case of smaller lengths, pulling is carried out by manual labour and when the length is longer by means of winches or other mechanical means.

While pulling with a rope, care is necessary to avoid bending of the cable a close watch should be maintained to ensure the cable runs freely over the cable rollers and passes smoothly without rubbing against any surface.


Great care is taken in the manufacturing of cable to ensure quality at every stage.

Handling of cable at site is the next important factor to ensure that by mishandling the cable, the outer sheath and insulation shall not be damaged.


The handling is generally carried out by unskilled or semi-skilled men, strict supervision should be maintained so that the cables, which can be very easily damaged, are handled with great care.

DO


When offloading reels from a truck, lower reels carefully using a hydraulic gate, hoist or forklift truck.

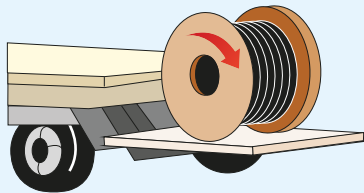


If a forklift is used for handling and shifting the cable drum, the forks shall approach the reel from the flange side. The forks shall be positioned such that the reel is lifted with both reel flanges.

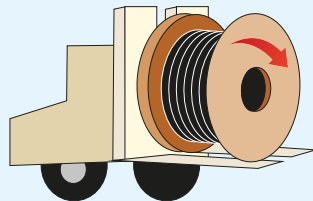

When using a hoist, install a mandrel through the reel arbor holes and attach a sling. Use a spreader bar approximately 6 inches longer than the overall reel width placed between the sling ends just above the reel flanges.




It is always safer to use a strong and well-drained surface for storing drums. If possible, the drums should be raised from the ground by the insertion of wooden planks, etc., below and on both sides of the drums: some check pieces should be placed so as not to allow the drums to be rolled and easily. Cable drums should also be stored away from the direct sun and rains. Reason: Direct sunrays can cause deterioration due to UV rays and rain can cause damage to wooden drum, resulting drum collapse after a few months.




DON'T

Never drop reels. If reels must be rolled, roll in opposite direction of the cable wraps to keep cable from loosening on the reel.




Do not allow the lift forks to contact the cable. Care must be taken by the forklift operator not to make sudden turns or stops.

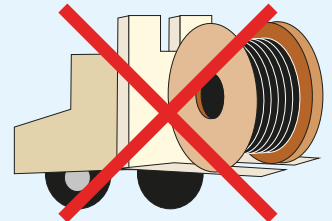

This may lead to the bending of the reel flanges and mashing the cable.




Multiple reels stacked on top of each other (Pancake Storage) is not recommended for cable drums. The weight of the stack can total thousands of kgs. creating an enormous load on the bottom reel. Also, damage to the reel and/or cable will likely occur when the reel is flipped for transit. A concentration of stress on the reel flange may cause it to break and subsequently damage the cable.




DO


Always use proper stoppers to prevent the drum from rolling.

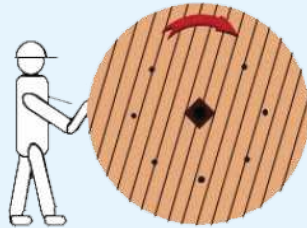


Ensure stoppers for every drum, to prevent mishaps during storage. Place the wedges by the flanges/full width of the drum

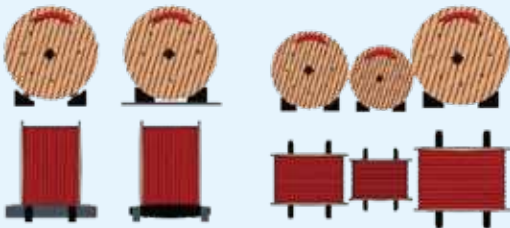


During transportation, fasten drums to the base through the central hole.

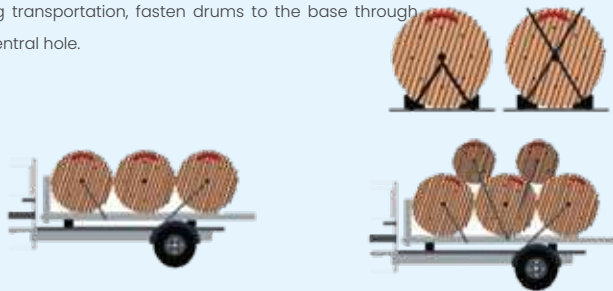

Use a winch, forklift or makeshift ramp

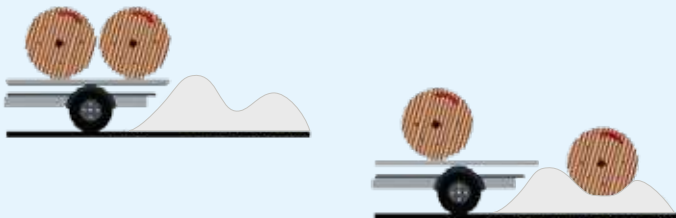


ON THE GROUND CABLE CAN BE FLAKED IN A FIGURE OF EIGHT FORMATION

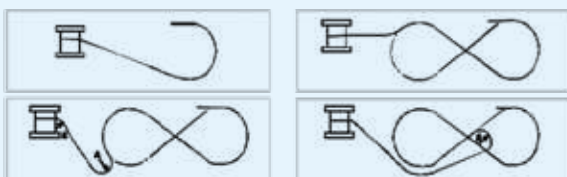

DON'T

When rolling in the direction of the arrow, never roll for more than 5 meters, Otherwise the cable may become unfit for use.

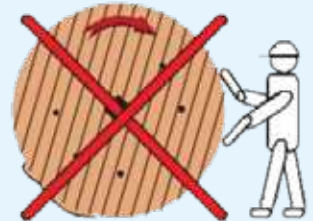


Allow the drums to roll at any cost. Stack the drums on non-triangular / non-square wedges.



fasten without taking adequate care. Always use support, and tie the drum from both the front and rear.



Allow one drum to strike another

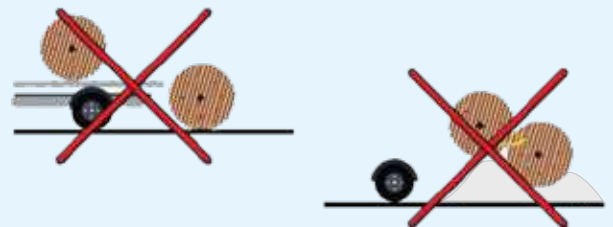

DON'T ATTEMPT COILING OF CABLE ON THE GROUND



10+
Countries
Across globe

Regional Office:

- Chennai** : No. 36, Govindappa Naicken Street, Parrys, Chennai-600 001.
- Bangalore** : No.105, Paras mansion, 025, Brigade Rd, Ashok Nagar, Bengaluru, Karnataka-560025.
- Telangana** : Suryakiran complex, 203, Second Floor, SD Road, Secunderabad, Telangana-500003.
- Jodhpur** : Panji ka Bera, Pal Rd, opp. Paliwal Hospital, Gayatri Nagar, Jodhpur, Rajasthan-342008.
- Chhattisgarh** : S P Cold Storage, Near Khamtarai Railway Cross Khamtarai, (C.G) Raipur-492001

Manufacturing units

- Gujarat** : Survey No. 2450, Ahmedabad-Mehsana Highway, Village - Rajpur, Taluka, Kadi, Gujarat-382715.
- Delhi** : 179, FIE Patparganj Indl Area, Delhi-110092.
- Chennai** : 40/3 Inner Ring Road, Manjambakkam, Chennai-600 060.
- Mumbai** : Shripal Industrial Estate, Bldg. No. 3, Wing-C, Gala No. 17, Near Gyandeep School, Waliv, Vasai (E)-Palghar - 401 208.

18+
States
Across India



AN ISO 9001 : 2015 ¹⁴⁰⁰¹ Company

ORBIT WIRES INDIA (PVT) LTD

Survey No. 2450, Ahmedabad - Mehsana Highway,
Near Scoda Tubes Limited, Village - Rajpur,
Taluka - Kadi, District - Mehsana, Gujarat - 382715.

Customer Care : 79000 39000
Email ID: sales@orbitcables.com
Website : www.orbitcables.com





Survey No. 2450, Ahmedabad - Mehsana Highway, Near Scoda Tubes Limited,
Village - Rajpur, Taluka - Kadi, District - Mehsana, Gujarat - 382715.

www.orbitcables.com | sales@orbitcables.com